



ECS Report: Key Findings

Summary of findings dated April 8, 2025 for Covington Middle School.

SUMMARY OF FINDINGS FROM TESTING CONDUCTED ON MARCH 24 AND 31, 2025



Relative humidity was **not elevated**.



Temperature was in **typical range**.



NO elevated CO during site visit.



CO2 **below OSHA limit** of 5,000 ppm.



ECS personnel did **NOT observe any urine-like odors** while on site.

CONCLUSIONS



The source of the urine-like odor reported on several occasions remains unknown.




Given the repeated concerns about odor in the building, AHPS is making investments to improve overall air circulation and ventilation.



To increase fresh air access and improve building ventilation, AHPS and Covington Middle School have:

- Ordered temporary window units to increase airflow and ventilation.
- Procured a new and more efficient air handling system to replace the RTU-4.

PPM

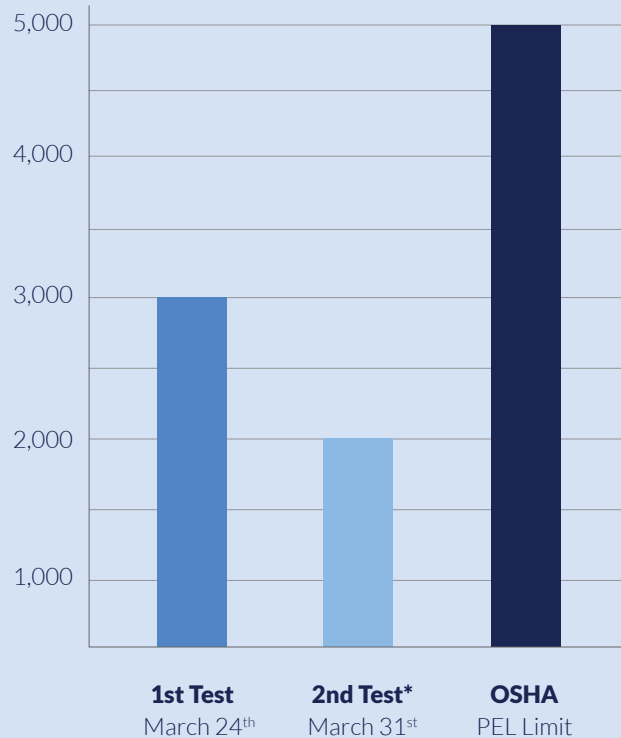

*2nd test run with operational RTU-4 deployed